



AMBIRAD

HEATING AND VENTILATION SOLUTIONS

SmartCom

Energy Management Control



AMBIRAD **NORDAIRNICHE** **BENSON**



SmartCom

Energy Management Control



AmbiRad has introduced SmartCom3, an intelligent energy management controller, in order to satisfy the growing need for higher efficiencies and to complement the development of efficient heating systems.

Simple to program and operate, SmartCom3 provides cost-effective energy management for small single heater installations through to large multi-zone applications requiring centralised control.

Functions

- > Self adapting optimised start with auto pre-heat adjustment
- > Volt free remote on/off
- > Ability to communicate with up to 15 slave units which may be centrally controlled by one master control (SmartCom3 Multi-zone only)
- > Single stage heating/cooling
- > Hi/lo heat (two stage heating) warm air only
- > Three stage cooling or ventilation
- > Fully modulating heating and cooling
- > Clock update, temperature functions and program settings
- > Zonal lock out indication and reset functions
- > Multi-zone or split zone (radiant applications)
- > Up to three on and three off settings per day
- > Adjustable day and night settings 0-30°C
- > Pre-set night setback or frost protection

Applications

Universal applications – compatible with:

- > Radiant heaters
- > Freeblowing warm air heaters
- > Single heaters
- > Ducted warm air heaters
- > Air rotation units
- > Floor standing cabinet heaters


Features & Benefits

- > Easy to program – simple multi-key entry and on-screen prompts
- > Suitable for controlling heating and/or cooling
- > Reduced installation time – units can be networked via screened cable
- > Integral warm air temperature sensor
- > Factory shutdown frost protection
- > Optional remote air sensor, remote black bulb sensor, duct sensor or outdoor sensor
- > Alphanumeric backlit display with angled screen for easy viewing
- > Remote burner lock out facility
- > Easy-set overtime and holiday periods
- > Hours run metering and service data logging
- > Compact IP30 enclosure complete with top or bottom cable entry
- > Security – optional passwords prevent unauthorised access to unit
- > Dual temperature settings for sports/nonsports comfort heating
- > Lithium battery backup for program and clock retention



Multi-Zone System

Zone 1 Master Control

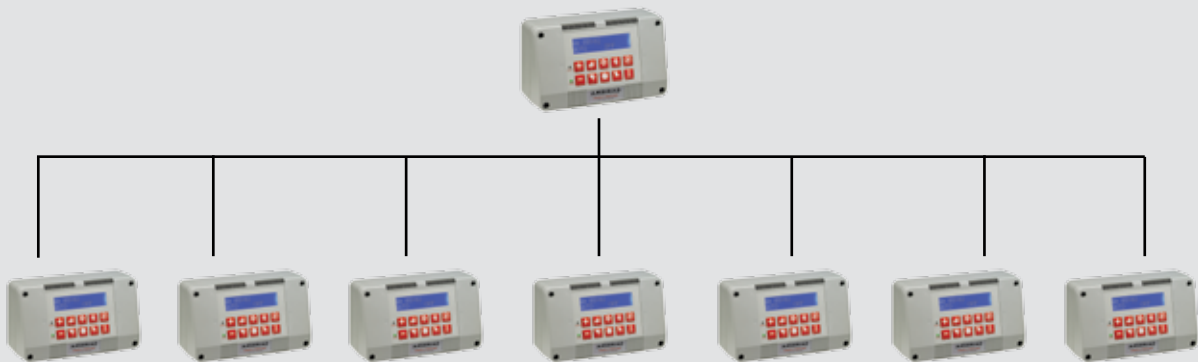

Up to 15 additional zone controls

Radiant Black Bulb Sensors

Essential for efficient radiant heating systems, black bulb sensors enhance the energy saving capability by measuring the effective radiant temperature within the space being heated.



Warm Air Sensors

Remote sensors for applications where the temperature sensor must be located away from the controller. Remote sensors can also be used for temperature averaging in conjunction with the controller's integral sensor.



Warm Air Duct Sensors

The sensor may be located in the return air duct (prior to any mixing with fresh air). Alternatively for make up air applications requiring a constant supply air temperature the duct sensor may be located in the supply duct to control hi/lo or modulating burners (SmartCom3 Multi-Zone only).



Modes of Operation

Auto Mode

For fully automatic control of combined heating and free cool ventilation or heating and cooling, the SmartCom³ panel will control the burner plus integral fresh air dampers or cooling coils where appropriate. It also ensures correctly sequenced operation of heating combined with ventilation or cooling.

Off Mode

All functions are switched off.

Heat Only

For control of simple heating only units the SmartCom³ standard provides on/off burner control and the SmartCom³ MZ control provides high/low or modulating burner control.

Fan Only

Controls two stages of ventilation during clock 'on' periods. The fan only facility is temperature controlled ensuring that it only operates if the temperature rises above the defined set point. A further 2°C rise in temperature operates the second stage vent where applicable.

Frost Only

For constant frost protection at 5°C (non adjustable). When the controller is set to holiday mode it will operate as frost only.



Increase a value



Decrease a value



Accept a newly entered value



Press once to cancel overtime, vent off and holiday modes or a newly entered value not yet OK'd. When in programming press once to revert to normal operation



Initialise programming sequence



Initiate a timed period of forced ventilation



Extend a period of heating



Set the control to holiday mode



Toggle the display between set and actual room temperatures



Clear a flame failure lockout

AMBRAD LIMITED

Fens Pool Avenue
Brierley Hill
West Midlands DY5 1QA
United Kingdom

Tel: 01384 489 700

Fax: 01384 489 707

ambiradsales@nordyne.com

www.ambirad.co.uk

